

- Cloud Chamber Detection Principle
- Upto 200 mtrs Sampling Pipe
- Programmable 'Pre-Alarm' warning condition
- 3 Programmable 'Fire' warning conditions
- Multi-function Display and Programmer
- 'Alarm' action text
- Vast Sensitivity Range (incipient to conflagrating)
- Latching / non latching alarm contacts
- Airflow Monitoring
- 'Fault Diagnostic' feature
- Immune to dust, humidity & temperature changes



### CLOUD CHAMBER FIRE DETECTOR

The 'sensitivity range' is the key feature that makes the Cirrus Pro Series Fire Detector the worlds most versatile fire detection device.

For over 20 years Cloud Chamber detectors have been known as the most sensitive fire detection device, able to detect at the true incipient stage of a developing fire.

The New Cirrus Pro Series Detectors have a vast sensitivity range capable of being even more sensitive than previous versions. In addition the detector may now be configured to be installed in heavily contaminated environments, such as polluted production and warehousing facilities.

### ALMOST UNLIMITED APPLICATIONS


**High Sensitivity Applications include:-** Computer Rooms, Clean Rooms, Control Rooms, Data Centres, Valve Halls, Archive Storage, Anechoic Chambers, EDP areas.

**General Sensitivity Applications include:-** Historic Buildings, Museums, Hospitals, Cathedrals, Theatres, Art Galleries, Clean Warehouses, Atria, Indoor Stadiums.


**Harsh Environment Applications include:-** Cold Storage Facilities, Specialist Production Facilities, Food Industry Facilities, Paper Production Facilities, Transportation Terminals, Flight Simulators, Aircraft Hangers, Prisons, Inaccessible Voids, Dirty Warehouses.

# Technical Specification

## Connections

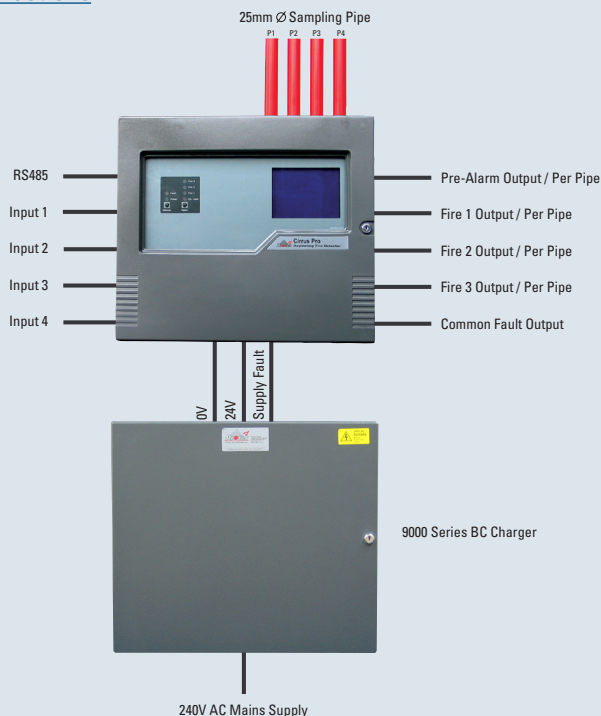

## Dimensions (mm)

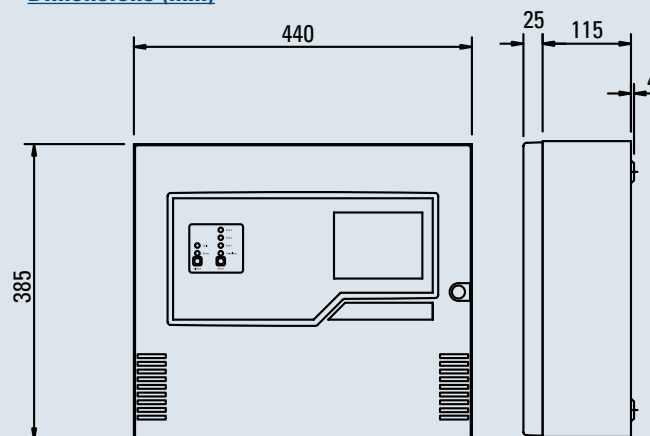

## Technical Specification:

<b>Supply Voltage</b>	20 - 29VDC
<b>Power Consumption</b>	14 watts in alarm
<b>Current Consumption</b>	550mA quiescent 700mA alarm
<b>Dimensions</b>	(W) 440mm, (H) 385mm (D) 144mm
<b>Weight</b>	9kg (19.8lbs)
<b>Operating Conditions</b>	
<b>Detector Ambient</b>	0°C to 38°C (32°F to 100°F)
<b>Tested to</b>	0°C to 55°C (32°F to 131°F)
<b>Sampled Air</b>	-20°C to 60°C (-4°F to 140°F)
<b>Humidity</b>	10 - 95%RH, non-condensing
<b>IP Rating</b>	IP30
<b>Cable Access</b>	20 x 20mm knock outs 4 x 22.5mm knockouts
<b>Cable Termination</b>	Screw terminal blocks (0.2 - 2.5mm <sup>2</sup> , 30 - 12AWG)
<b>Sampling Network</b>	Four inlet ports with combined sampling pipe length up to 200m (650ft.) Maximum Transport Time allowed up to 120 seconds.
<b>Alarm Indications</b>	Pipe 1: Pre-alarm, Fire 1, Fire 2, Fire 3. Pipe 2: Pre-alarm, Fire 1, Fire 2, Fire 3. Pipe 3: Pre-alarm, Fire 1, Fire 2, Fire 3. Pipe 4: Pre-alarm, Fire 1, Fire 2, Fire 3.
<b>Other Indications</b>	Supply Healthy, General Fault.

<b>Sensitivity Range</b>	20,000 particles per cc to 3 million particles per cc 10 programmable sensitivity ranges.
<b>Programmable Inputs</b>	4 monitored inputs that may be configured for Isolate, Reset, Disable, Fault, Gain Set, Battery Fault and Mains Fault.
<b>Programmable Output Relays</b>	17 Relays rated 1A @ 30VDC (Volt-free change over contacts)
<b>Event Log</b>	128 events stored on FIFO basis
<b>Data Retention</b>	Approx 10 day historical graph.
<b>Variable Sensitivity Settings</b>	7 day programmable settings with 3 time zones per day.
<b>Multi-function Display/ Programmer:</b>	Cirrus Pro 200DSC incorporates a quarter VGA backlit LCD. In normal conditions the Date, Time, Detector Text and Particle Levels are all displayed. Alternatively any Fault, Pre-alarm or Fire conditions will be displayed. Event Logs, 'Historical' and 'Real Time' graphs may also be displayed. The LCD display is also used in conjunction with the programming keys to commission each unit without need for a computer link.
<b>Airflow Monitoring</b>	High Airflow' and 'Low Airflow' fault monitoring.

Company Policy is one of continuous improvement, we reserve the right to change specification without prior notice

Protec Fire Detection Plc, Protec House, Churchill Way, Nelson, Lancashire, BB9 6RT

© 2011 - 2017 Protec Fire Detection plc